

Alternate positions for Blower exhaust system vented through scallop in base panel and vented through kick panel


Located in any position adjacent to side or rear panel

Blower exhaust system outlet fitted into 76mm hole in side panel (into refrigerator space cavity) (kick panel outlet not required)

Refrigerator space

Outlet vent in kick

Inlet grill over scallop in base panel

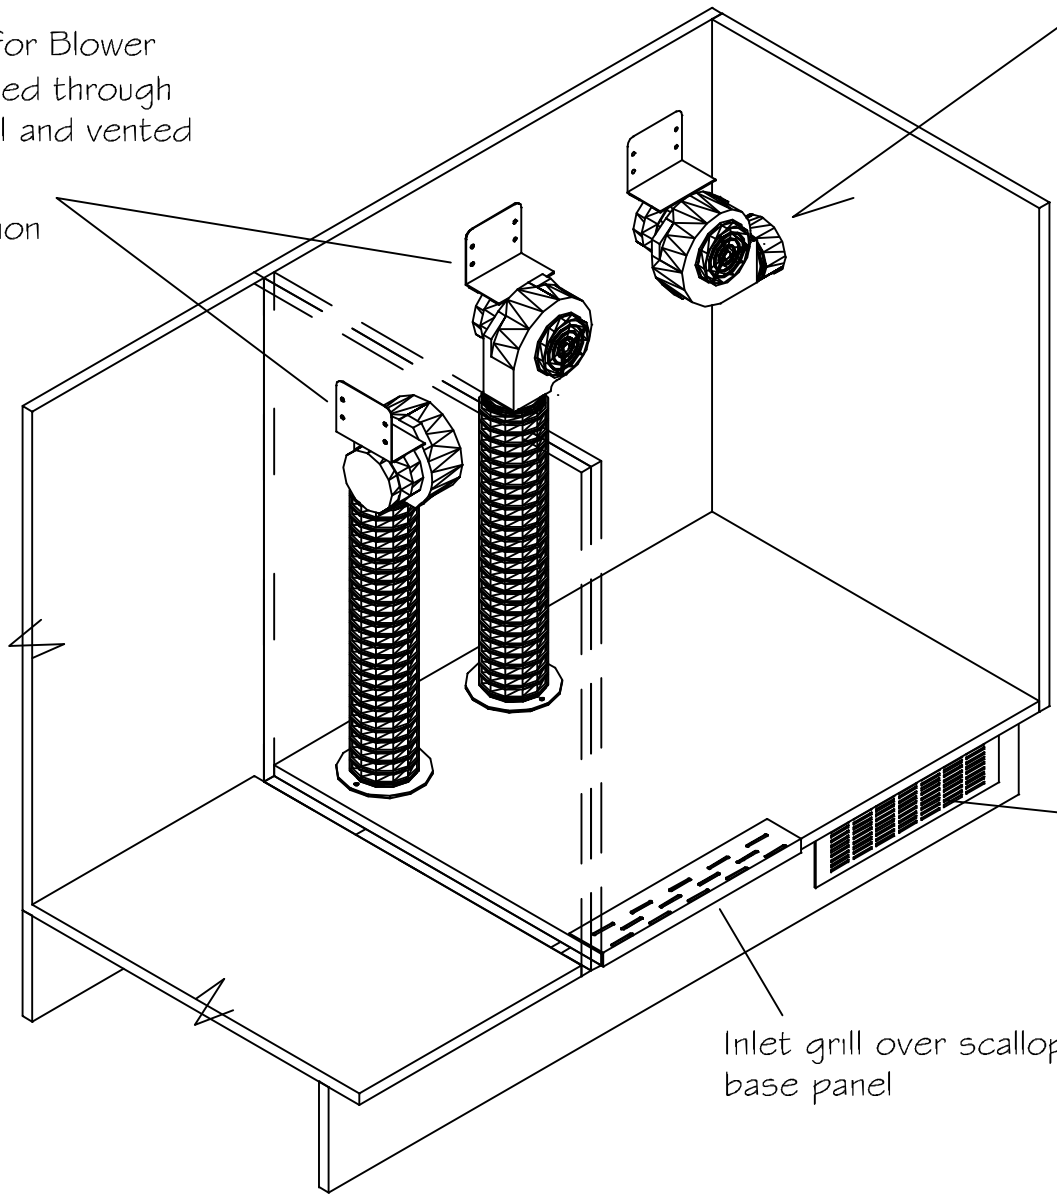

NOTES:

COPYRIGHT © 2009 WATERPLUS  
 LOGO: Terry Kimber  
 1 Coates Place  
 WESTON A.C.T. 2611  
 62882620 (w)  
 0401 636 888 (m)

DRAWING TITLE:  
**EXHAUST BLOWER LAYOUT**

CLIENT NAME:  
**WATERPLUS**

SCALE: <b>NTS</b>		
DATE DRAWN: 21/10/2009	DRAWN BY: TK	CHECKED BY:
DRAWING NUMBER:	ISSUE: A	SHEET: 1
CAD FILE: Exhaust_pump_assembly_location.dwg		